12V Internal BMS Wiring Diagram

12.8V Lithium Battery Bank | Internal BMS | 3kVA Multiplus 2x120
Expandable Solar + Alternator Charging | Advanced Monitoring & Control

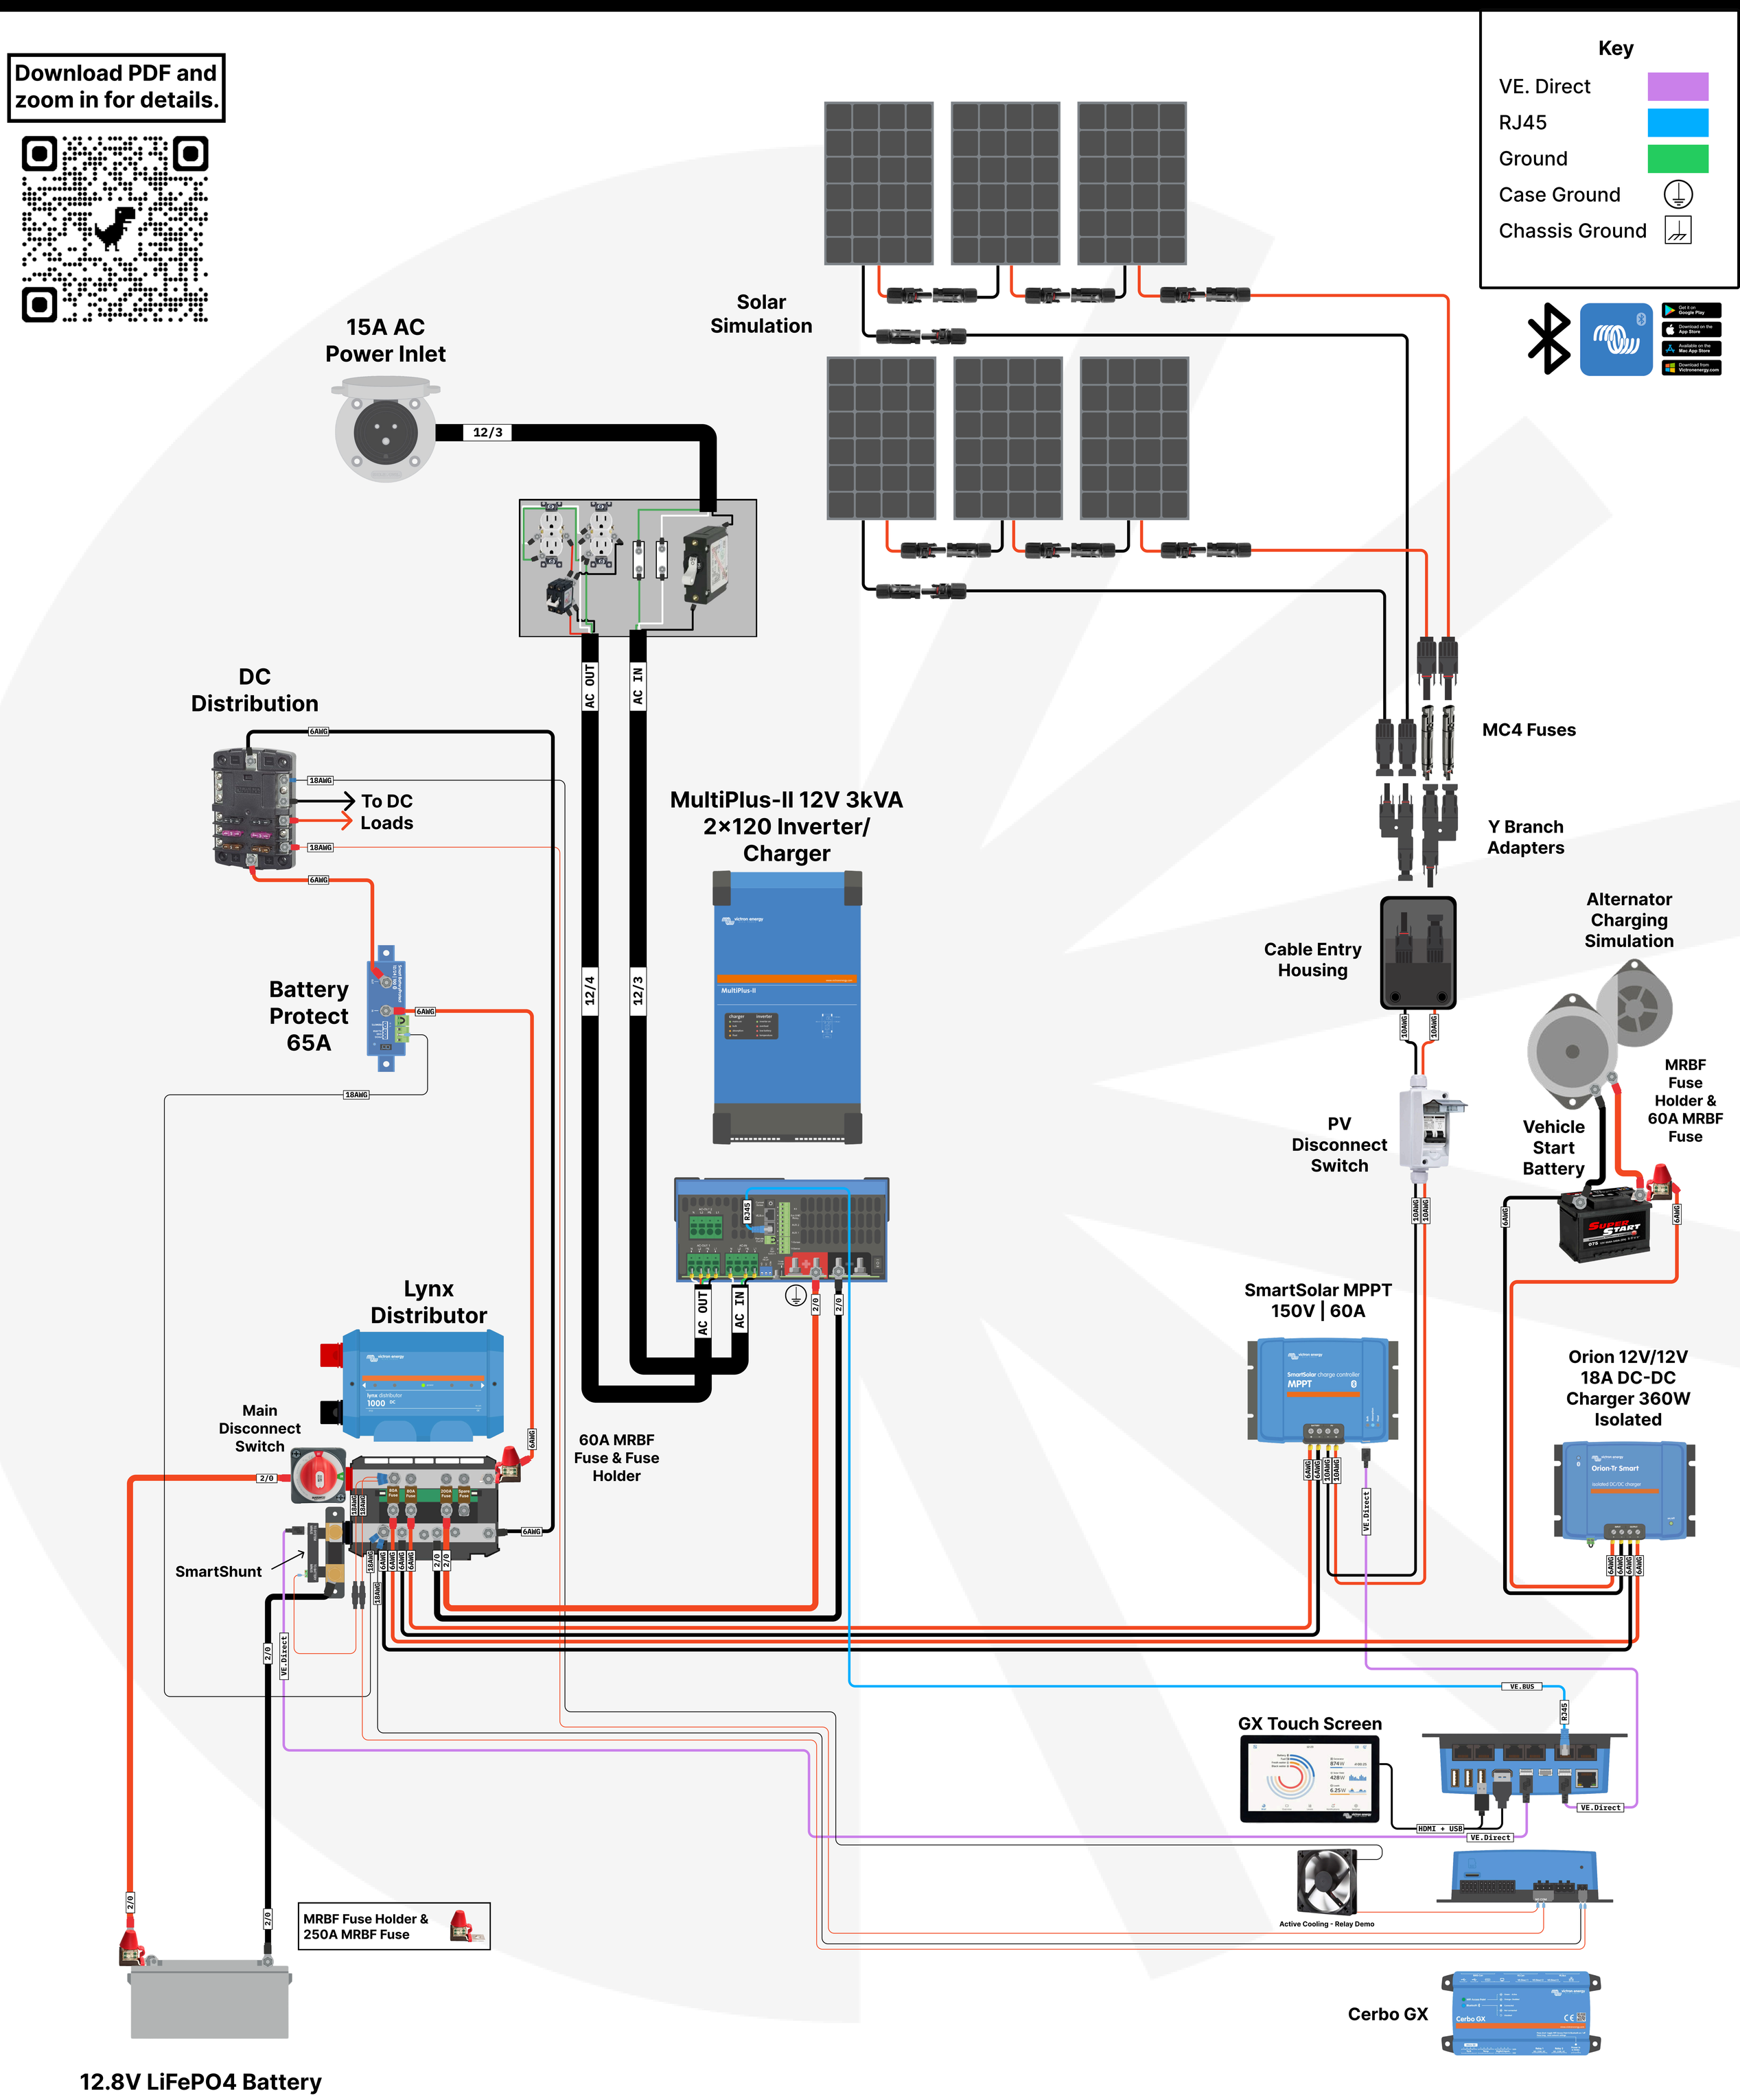

trek

Disclosure: This diagram is for training purposes only. Always follow manufacturer recommendations for battery bank sizing, and ensure solar array is properly sized based on system design considerations.

Copyright 2026 | Trek Systems